


Piute Springs

Map 1

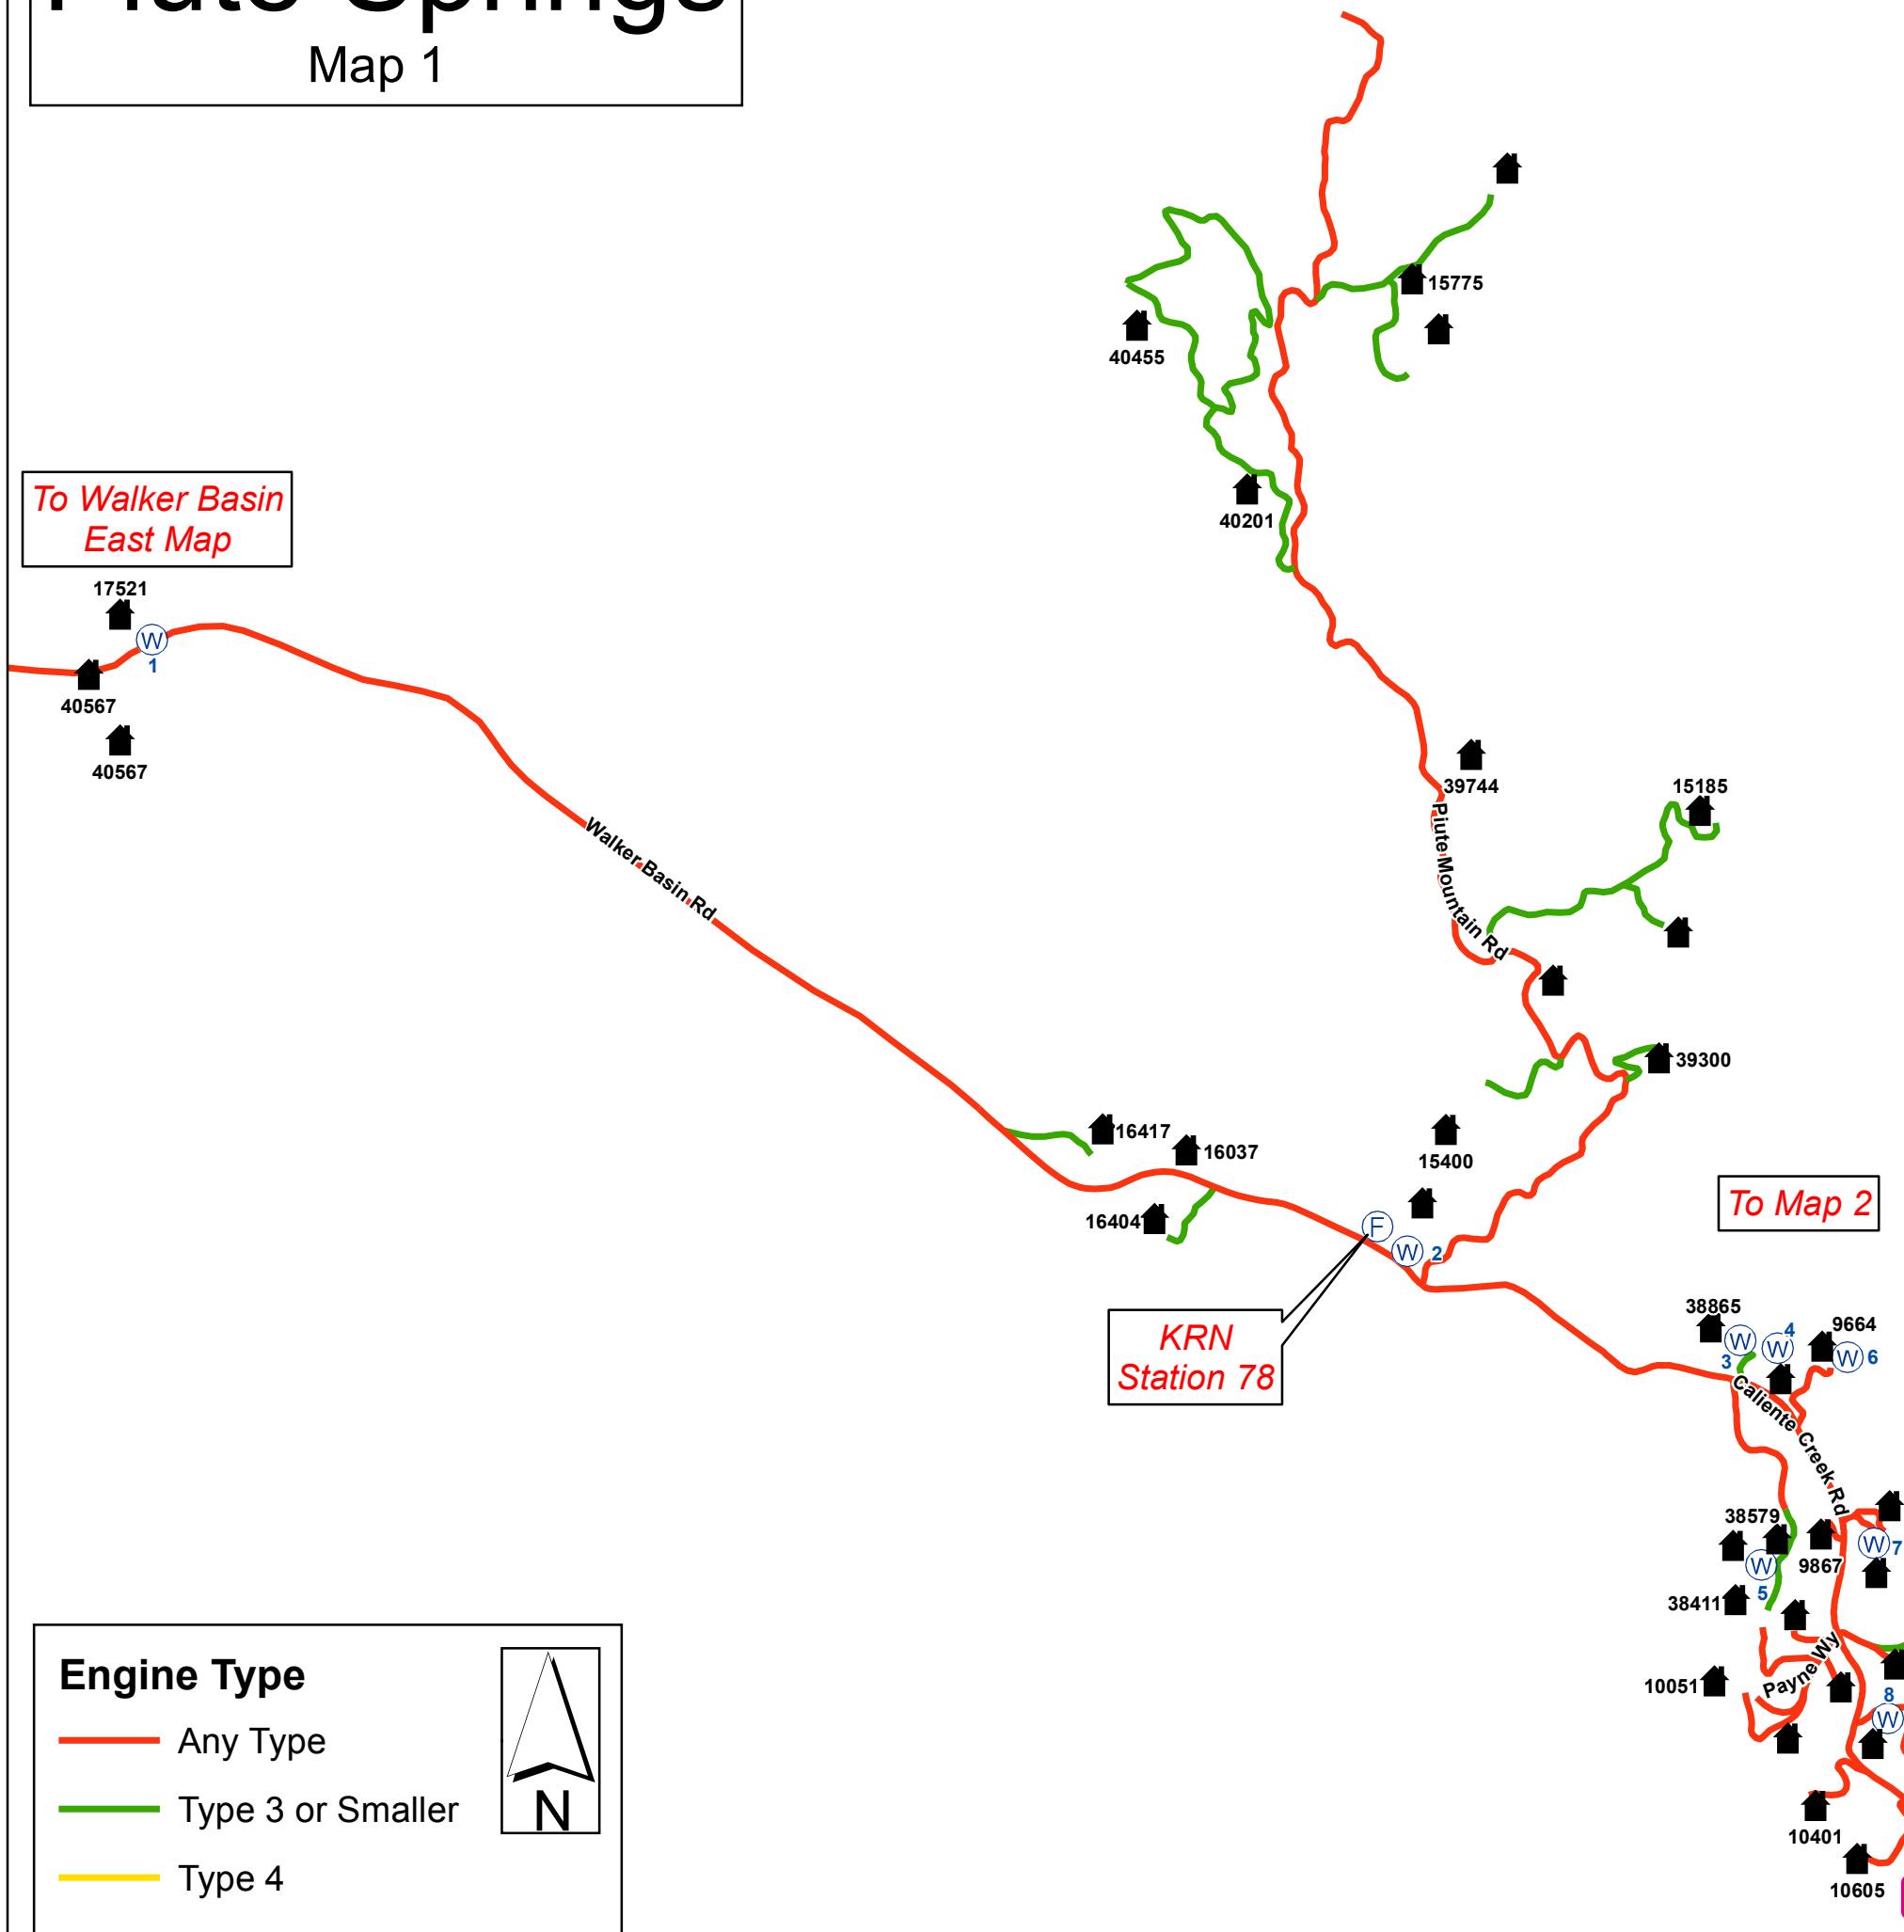

To Walker Basin East Map

To Map 2

Engine Type

- Any Type
- Type 3 or Smaller
- Type 4
- - - Impassible

Symbols

- F Fire Station
- W Water Source (Numbered)
- Structure (Addresses)

Special Notes

KCFD-GAS
ATP 05-07-10

**NO IDENTIFIED SAFETY ZONES
NO RECENT FUEL TREATMENTS**

Water Source Details			
Number	Capacity (ga)	Connection (in)	Notes
W1	3500	2.5 NS	Yard Hydrant
W2	3500	2.5 NS	Yard Hydrant
W3	3500	2.5 NS	
W4	8500	2.5 NS	Yard Hydrant
W5	3500	2.5 NS	
W6	6000	2.5 NS	
W7	3500	2.5 NS	
W8	3500	1.5 NS	Yard Hydrant

