

Digier Canyon Pre-incident Plan Map

Legend


- Structure address, if available; unknown
- Barn
- Diesel
- Gate
- Oil
- Safety *Suitable for 2 Strike Teams (6/2008)
- Staging
- Trash
- Water Tanks
- Crude Oil Pipelines and Abandoned H/P Natural Gas Line

Hydrants:

- Less than 500 gpm
- 500 to 1,000 gpm
- Greater than 1,000 gpm

Roads:

- Any type
- Type 3
- Type 4 Only
- Powerlines

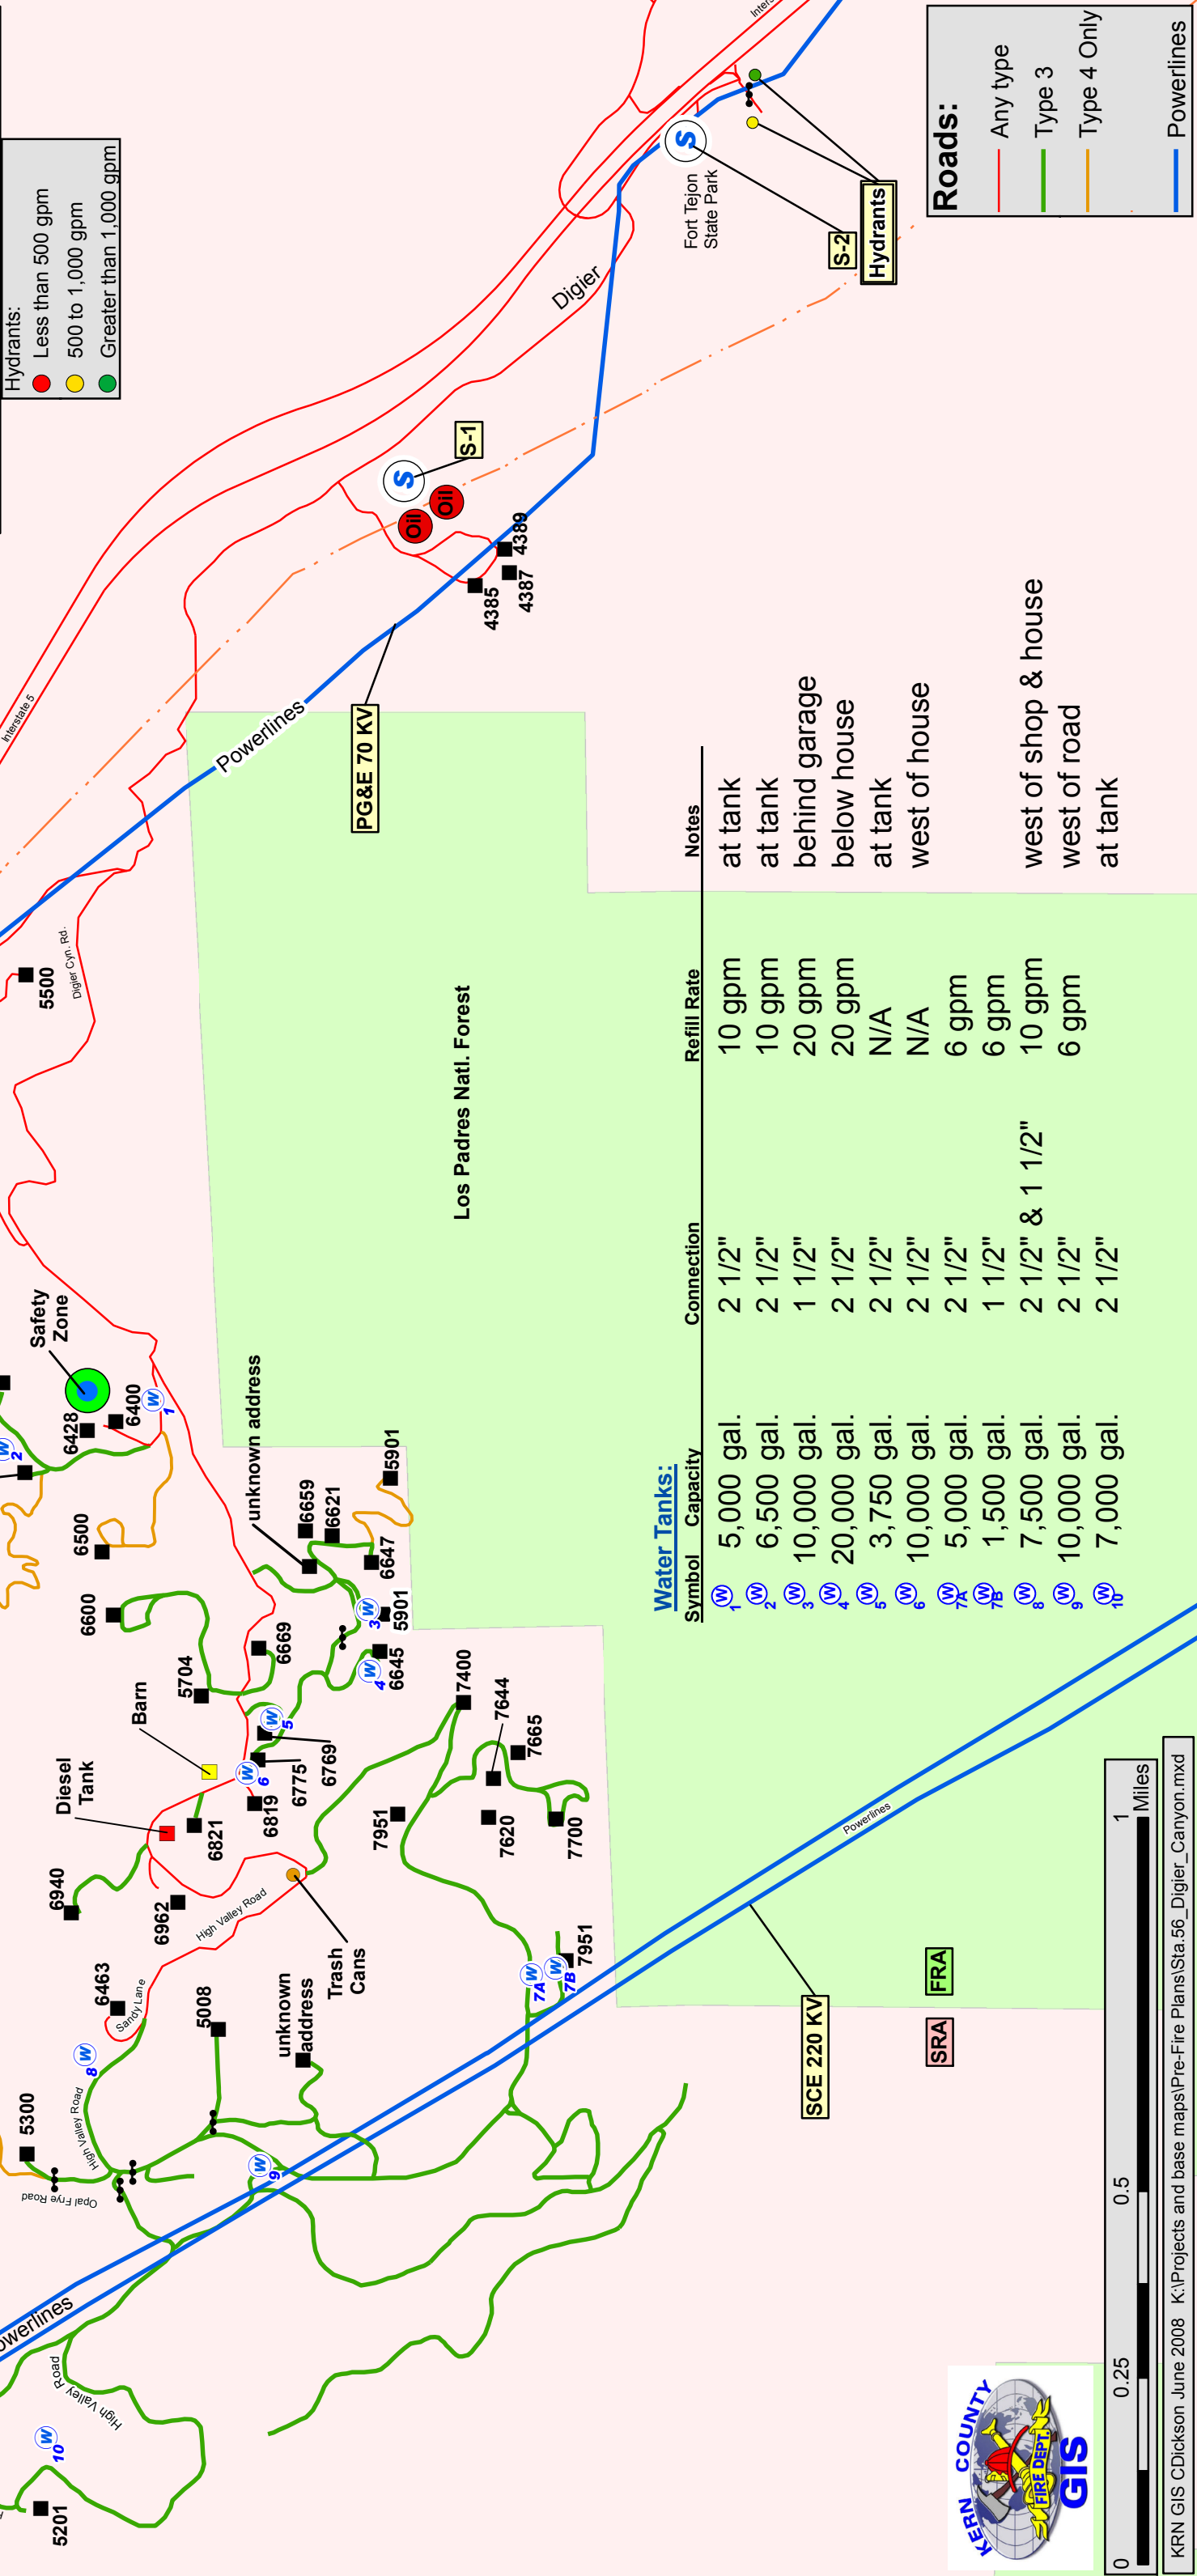

Water Tanks:

Symbol	Capacity	Connection	Refill Rate	Notes
1	5,000 gal.	2 1/2"	10 gpm	at tank
2	6,500 gal.	2 1/2"	10 gpm	at tank
3	10,000 gal.	1 1/2"	20 gpm	behind garage
4	20,000 gal.	2 1/2"	20 gpm	below house
5	3,750 gal.	2 1/2"	N/A	at tank
6	10,000 gal.	2 1/2"	N/A	west of house
7A	5,000 gal.	2 1/2"	6 gpm	
7B	1,500 gal.	1 1/2"	6 gpm	
8	7,500 gal.	2 1/2" & 1 1/2"	10 gpm	west of shop & house
9	10,000 gal.	2 1/2"	6 gpm	west of road
10	7,000 gal.	2 1/2"	6 gpm	at tank

