

Digier Canyon Pre-incident Plan Map


Legend

- Structure address, if available; unknown
- Barn
- Diesel
- Gate
- Oil
- Safety *Suitable for 2 Strike Teams (2/2016)
- S Staging
- Trash
- W Water Tanks
- - - Crude Oil Pipelines and Abandoned H/P Natural Gas Line



Hydrants:

- Less than 500 gpm
- 500 to 1,000 gpm
- Greater than 1,000 gpm

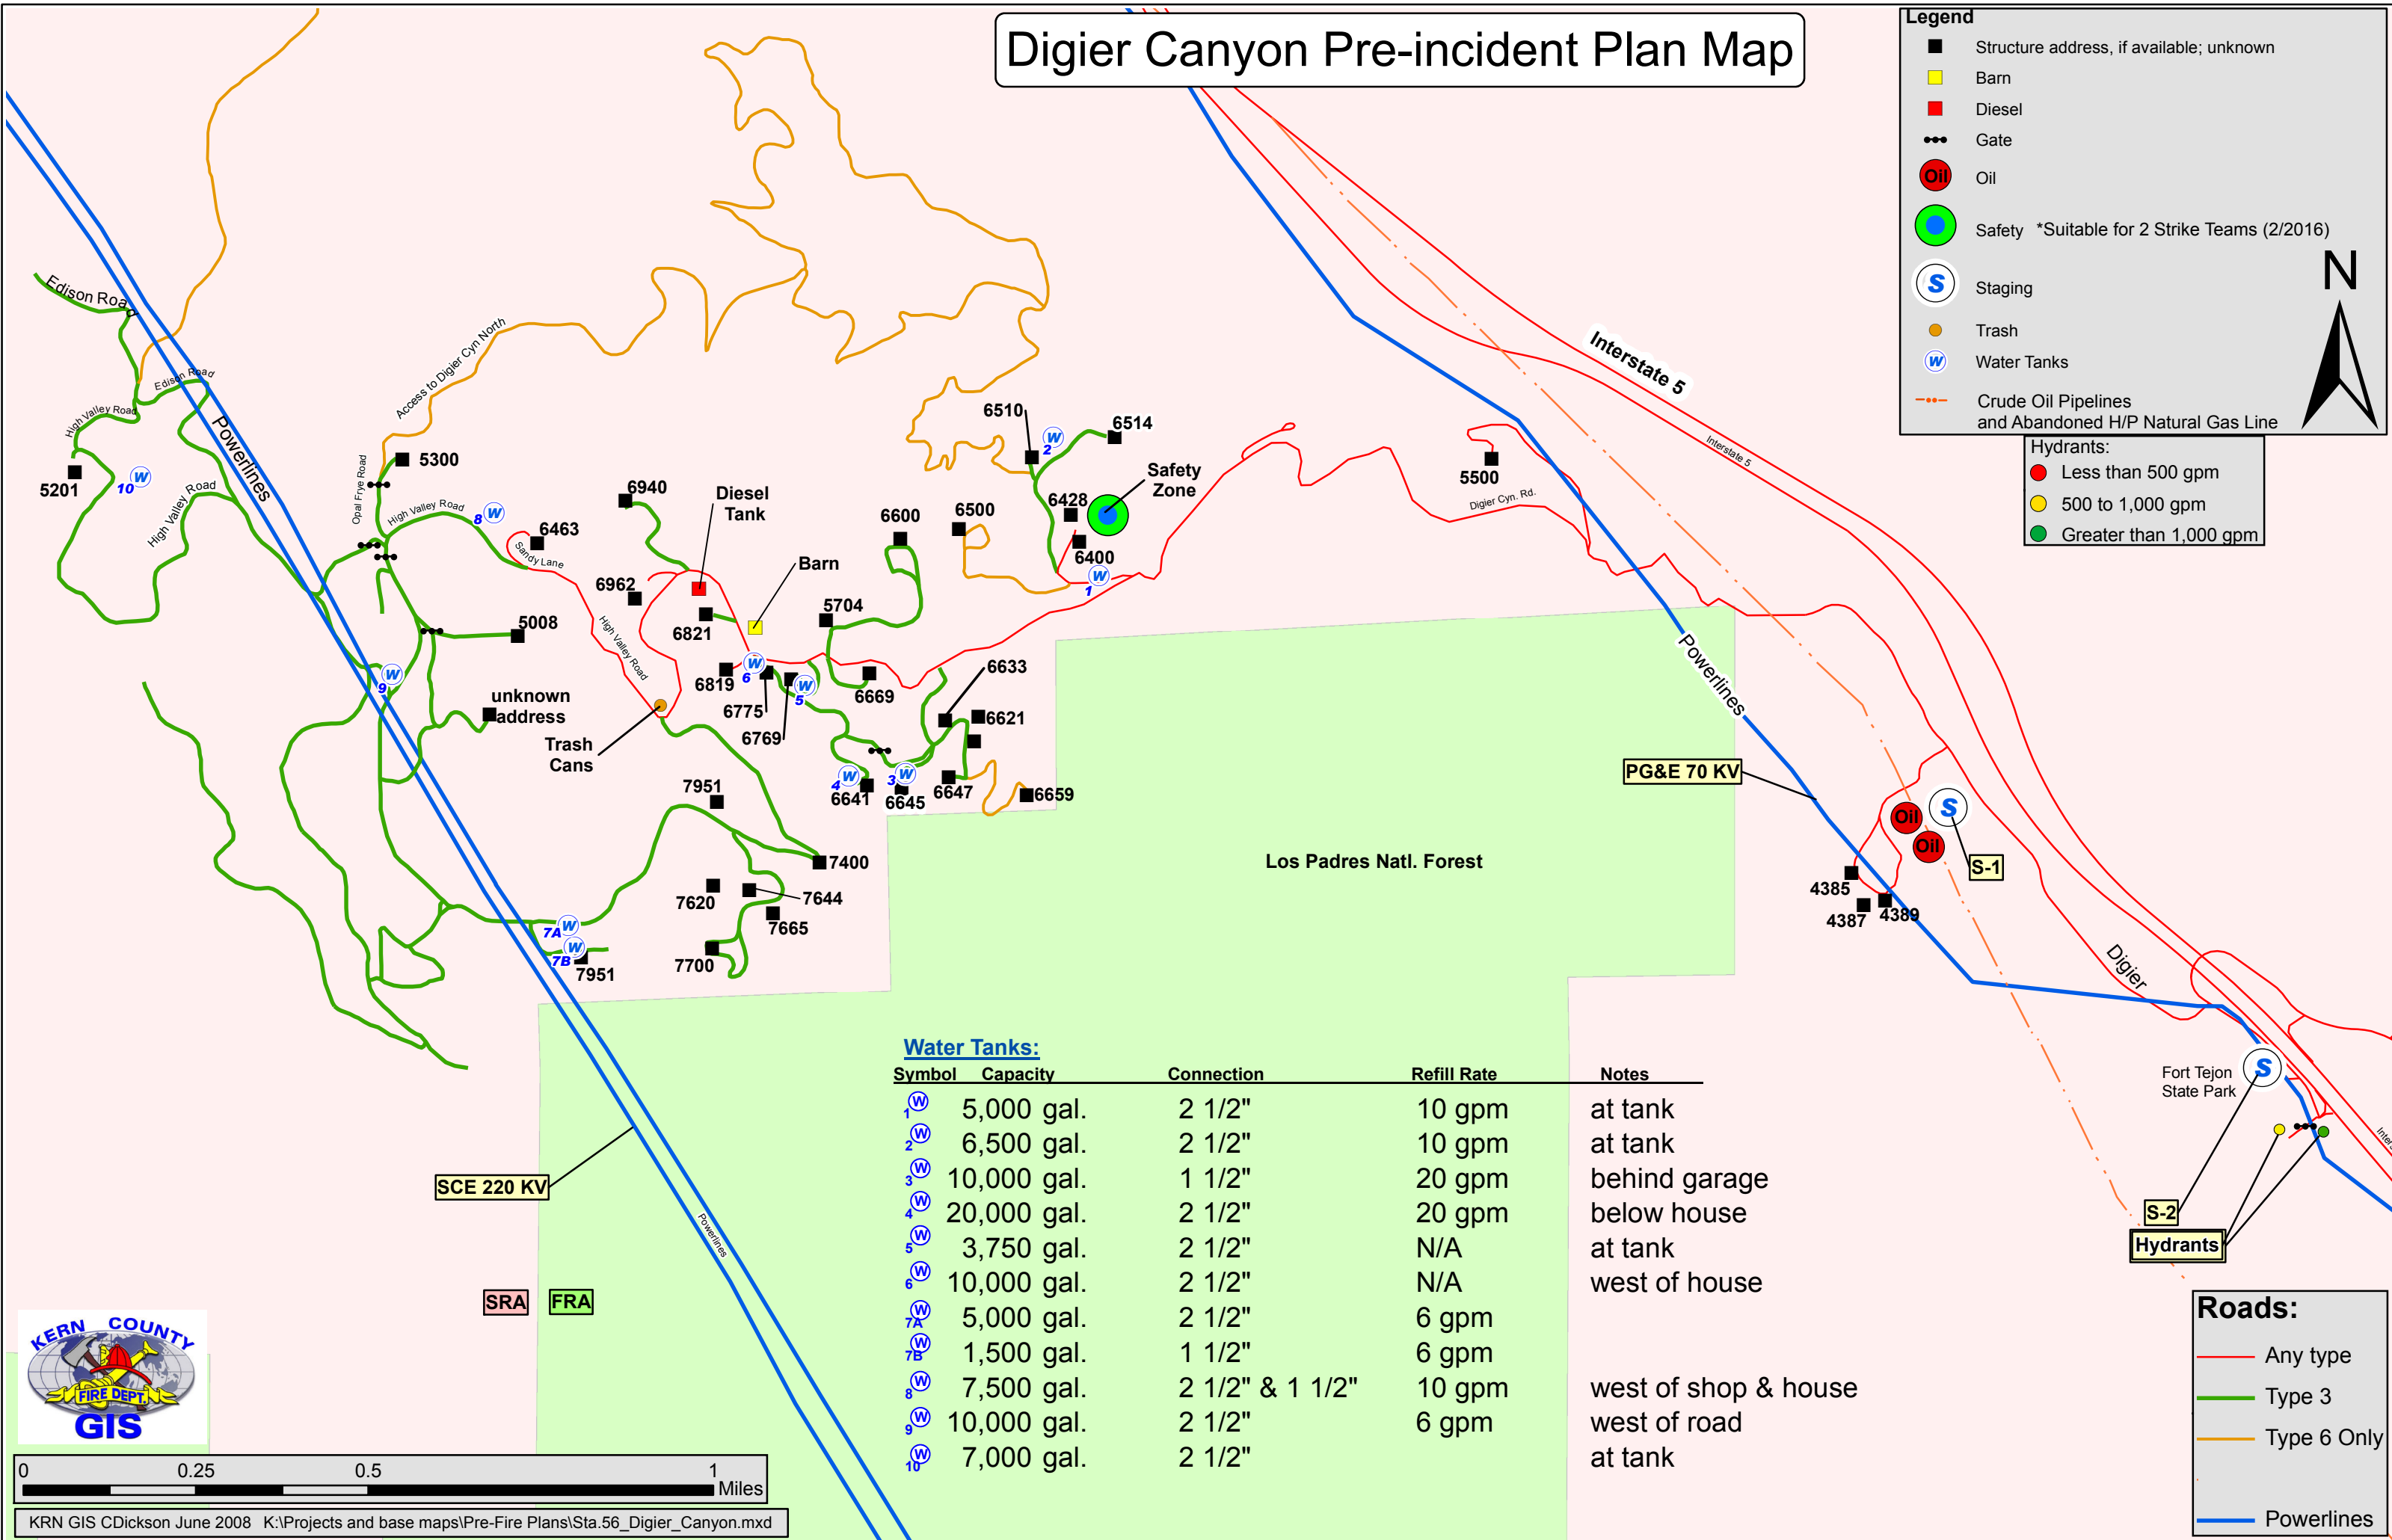

Water Tanks:

Symbol	Capacity	Connection	Refill Rate	Notes
1 W	5,000 gal.	2 1/2"	10 gpm	at tank
2 W	6,500 gal.	2 1/2"	10 gpm	at tank
3 W	10,000 gal.	1 1/2"	20 gpm	behind garage
4 W	20,000 gal.	2 1/2"	20 gpm	below house
5 W	3,750 gal.	2 1/2"	N/A	at tank
6 W	10,000 gal.	2 1/2"	N/A	west of house
7A W	5,000 gal.	2 1/2"	6 gpm	
7B W	1,500 gal.	1 1/2"	6 gpm	
8 W	7,500 gal.	2 1/2" & 1 1/2"	10 gpm	west of shop & house
9 W	10,000 gal.	2 1/2"	6 gpm	west of road
10 W	7,000 gal.	2 1/2"		at tank

Roads:

- Any type
- Type 3
- Type 6 Only
- Powerlines

